


CARBON NEUTRALIZATION **WITH MHI CENTRIFUGAL CHILLER**

EMS-81646


Sep. 2022



We deliver you comfortable space

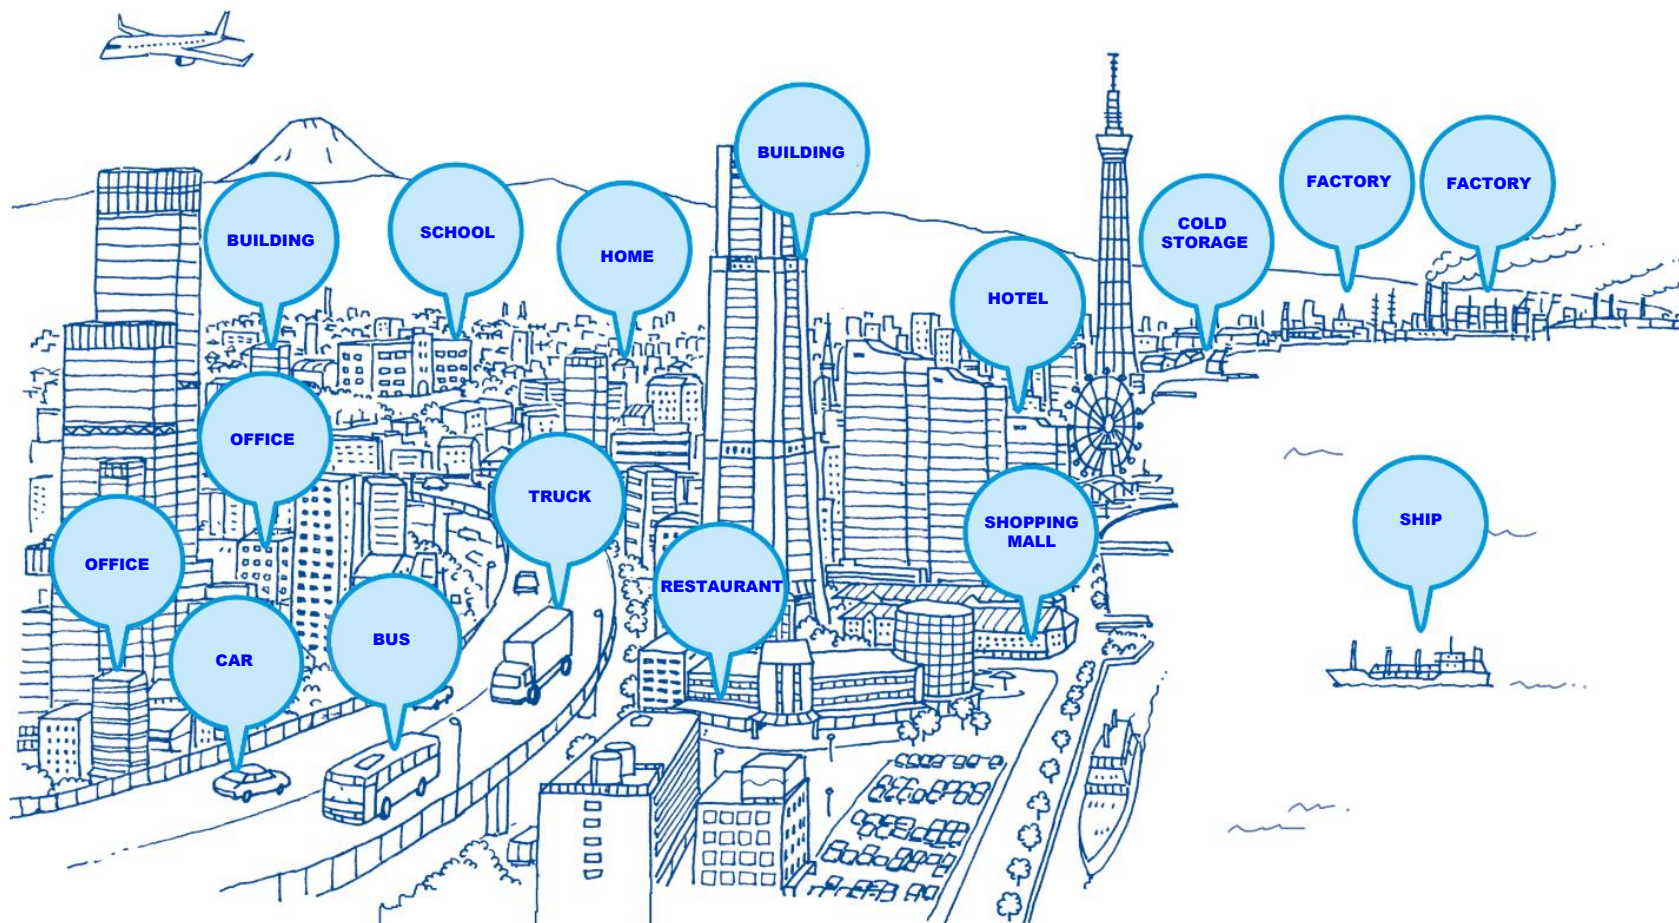

with **high energy efficiency** thermal solutions
friendly to global environment

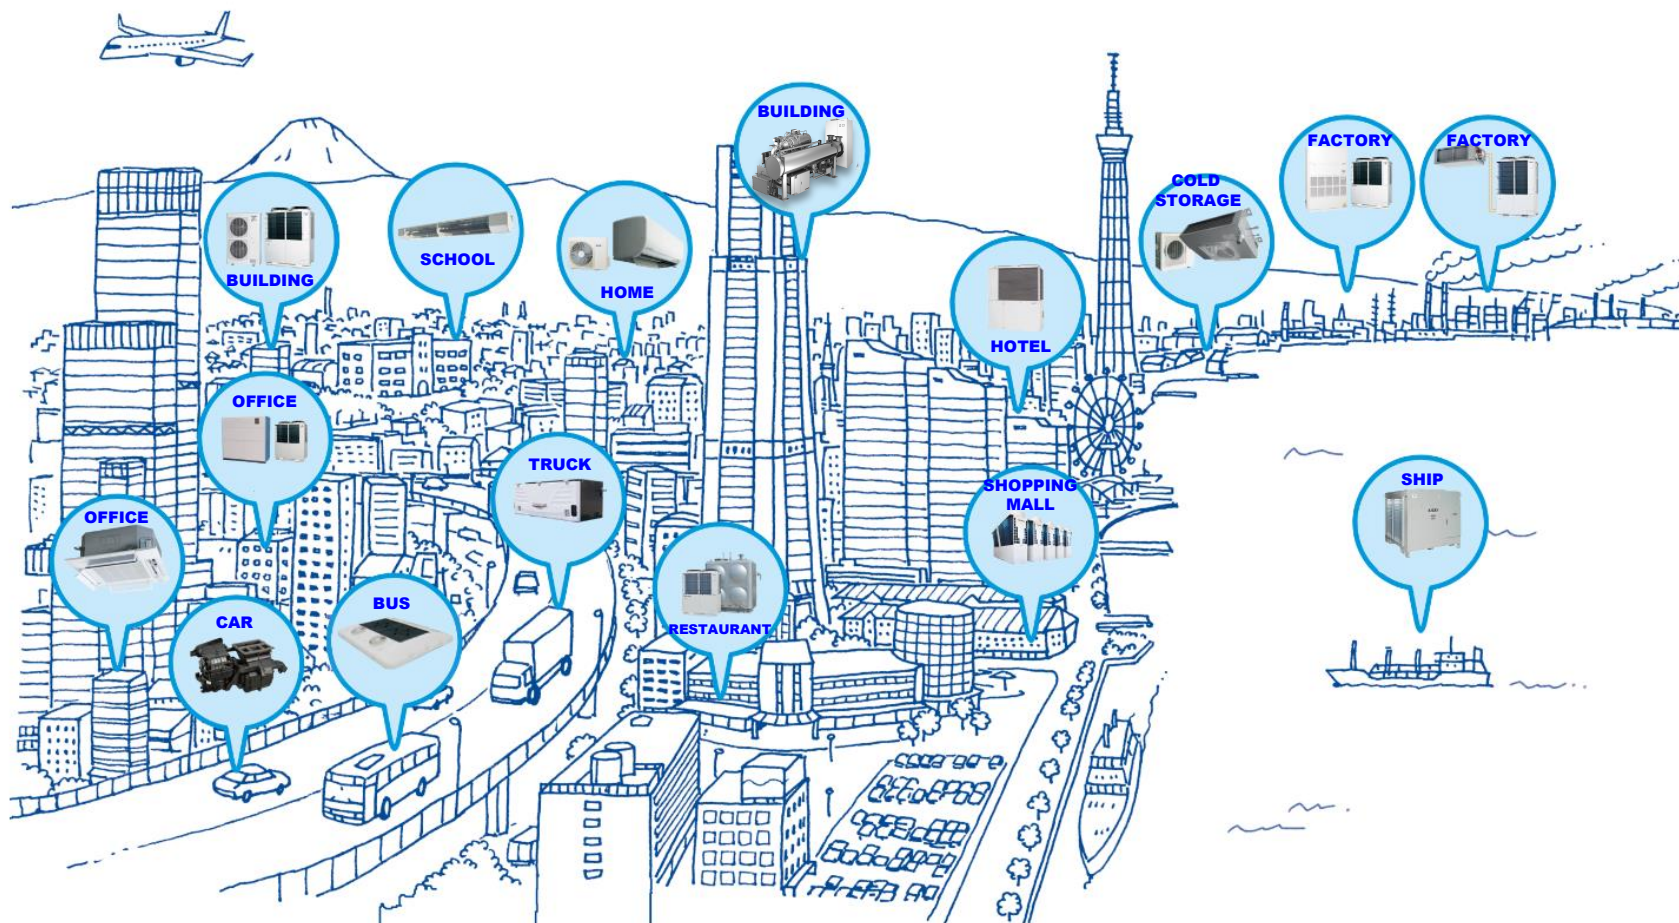

with **high energy efficiency** thermal solutions
friendly to global environment




Air-conditioners, Heat pump, Centrifugal chiller

with **high energy efficiency** thermal solutions
friendly to **global environment**





Introduction of Centrifugal chiller

**HIGH ENERGY
EFFICIENCY!**

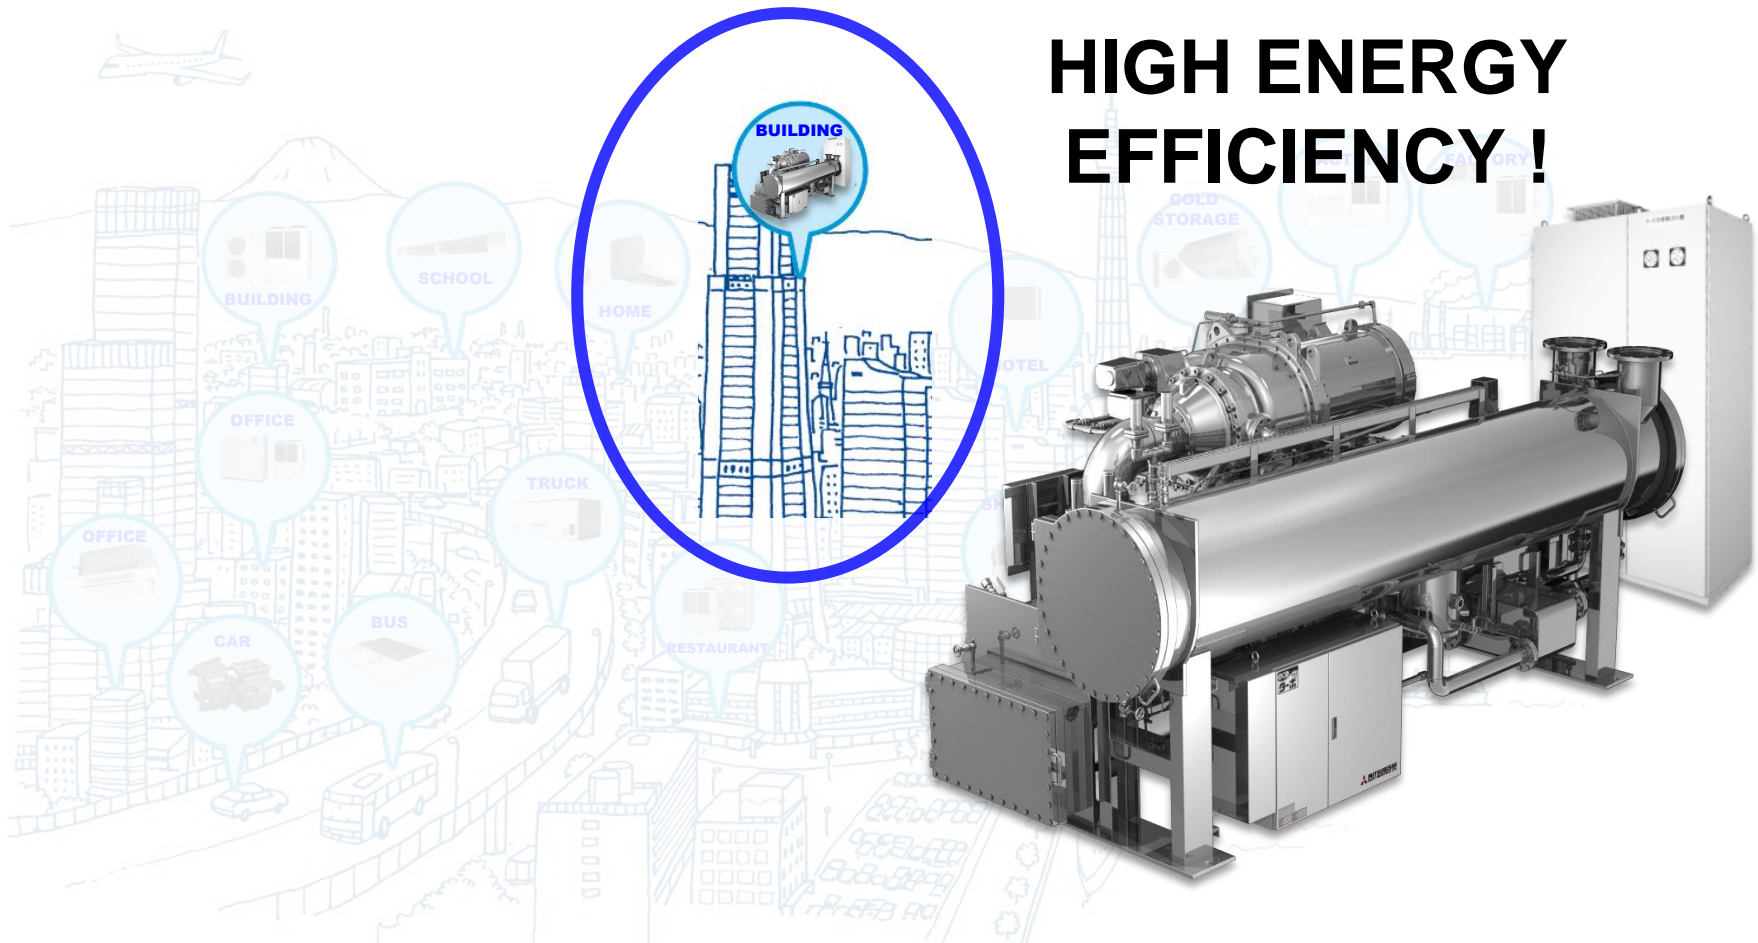


Introduction of Centrifugal Chiller : How it works

(Copyright © PIXTA)

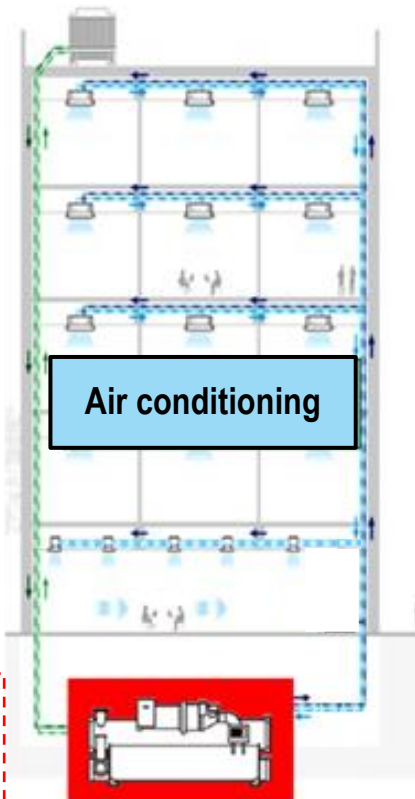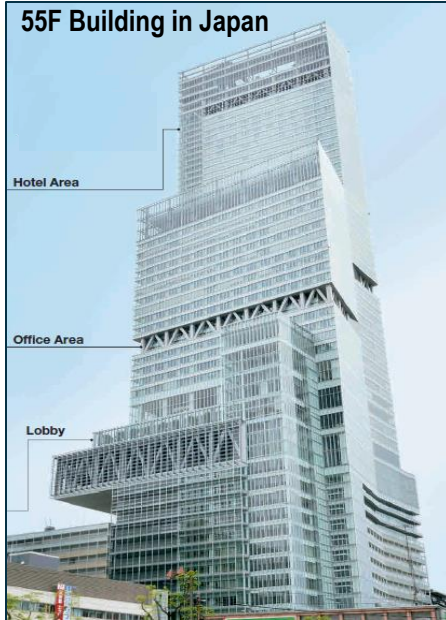

Building Air conditioning

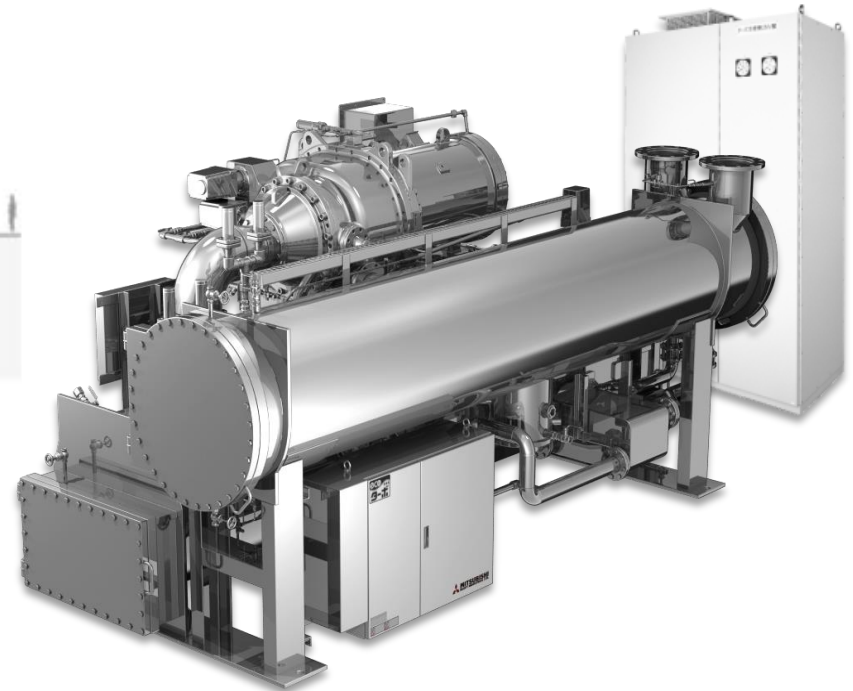

Chiller




Installed at the underground level

(Copyright © PIXTA)


Introduction of Centrifugal Chiller : Cooling capacity

**One Centrifugal chiller can cover
about 2000 units Air-Conditioner !**


**Cooling capacity
of 2000 units
room Air-Conditioner**
(Case of Air-Conditioner cooling capacity is 3.5kW)

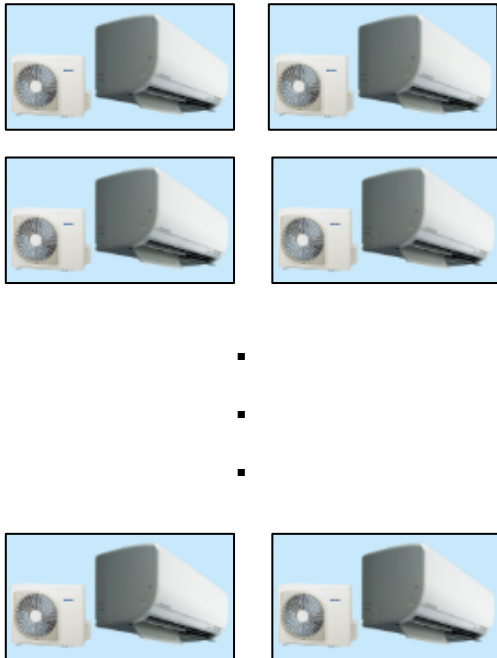

**Cooling capacity
of one unit
Centrifugal Chiller**
(Model: GART-250P case)


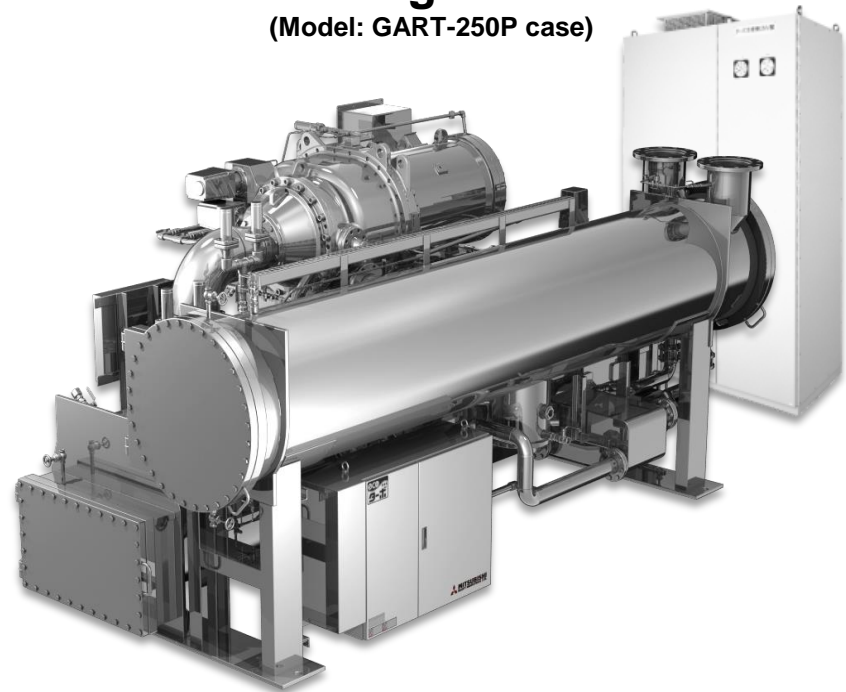


HOW CHILLER WORKS?

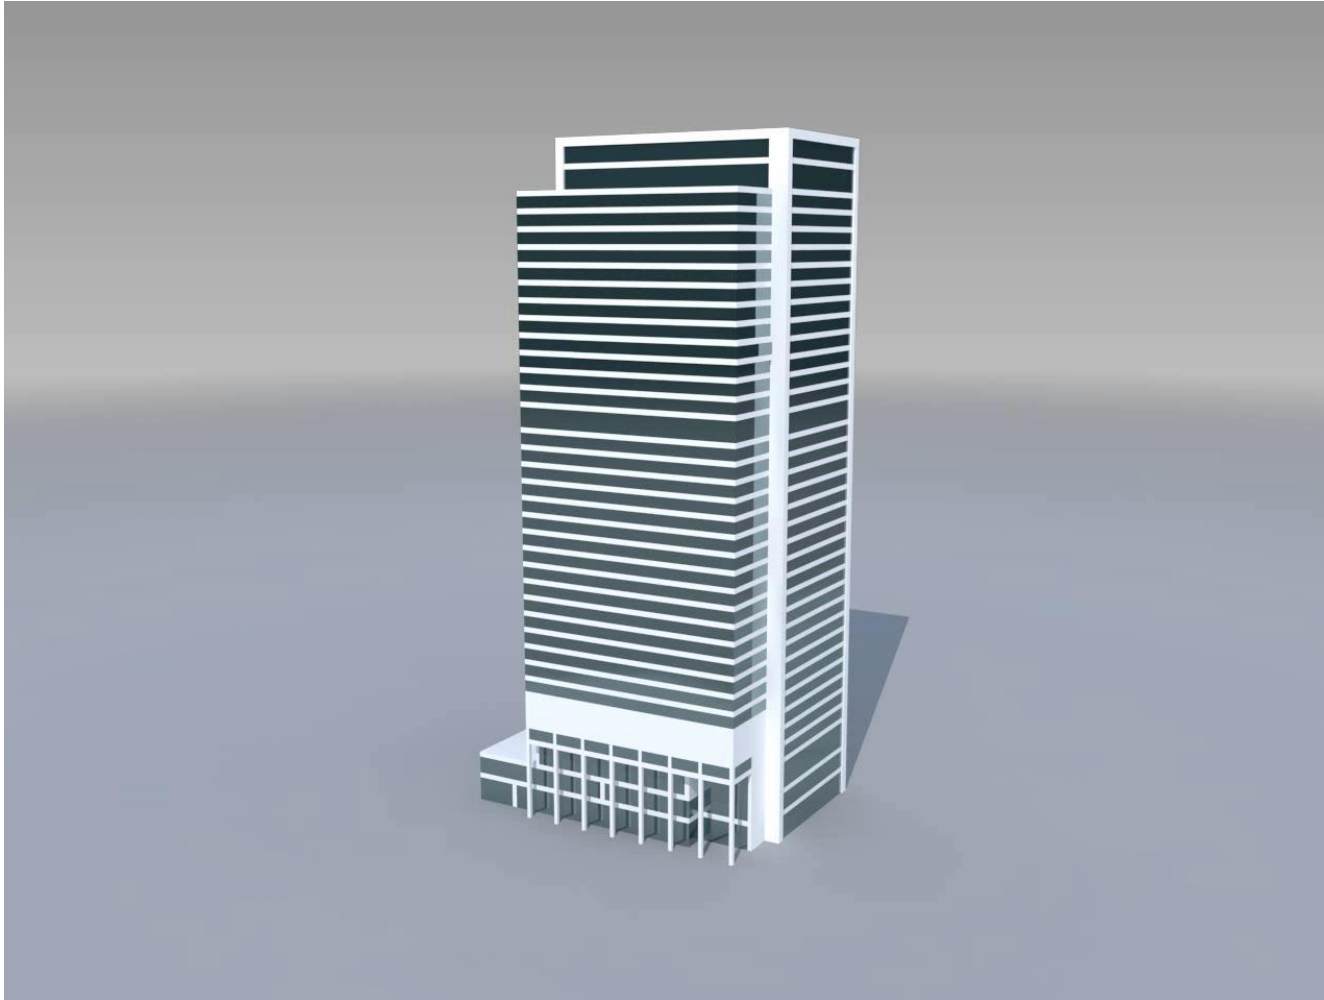

Introduction of Centrifugal Chiller : How it works

(Copyright © PIXTA)

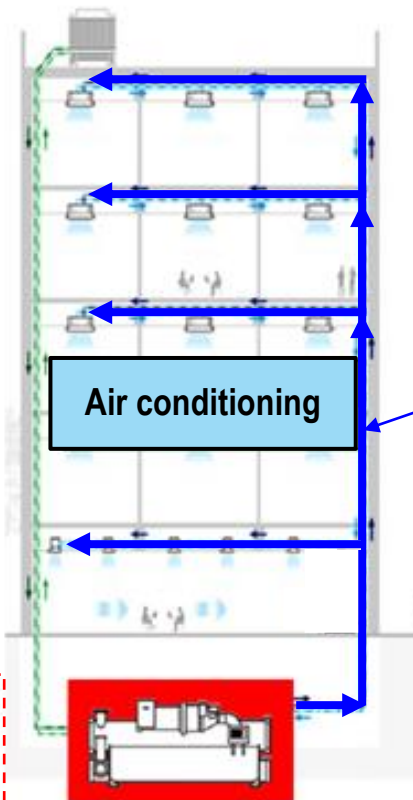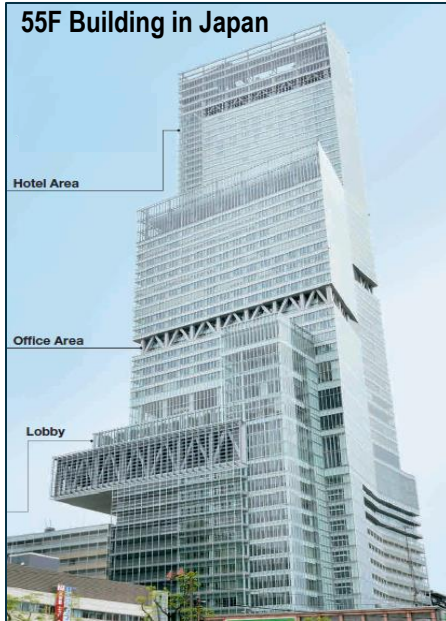


For Air conditioning
7°C* Chilled water
is provided by chiller

(*Normally 5 ~ 7°C)

Chiller






Installed at the underground level

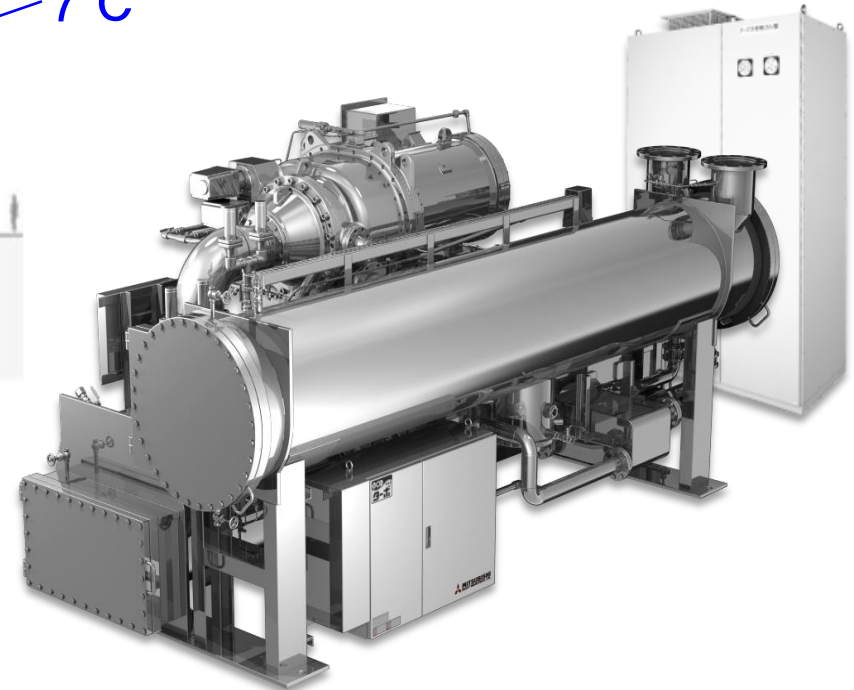

Introduction of Centrifugal Chiller : How it works


(Copyright © PIXTA)

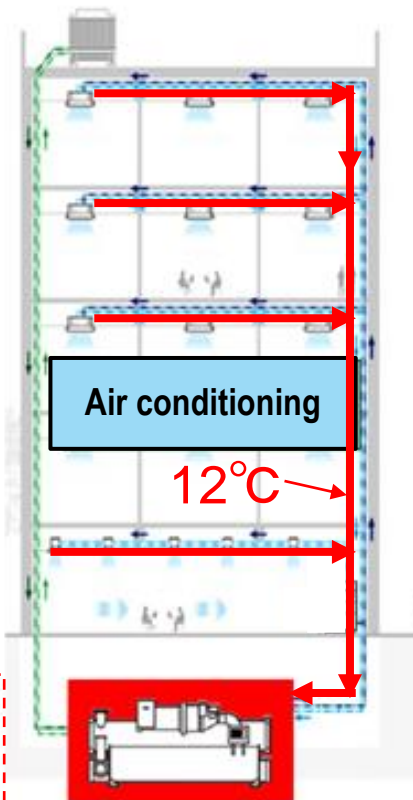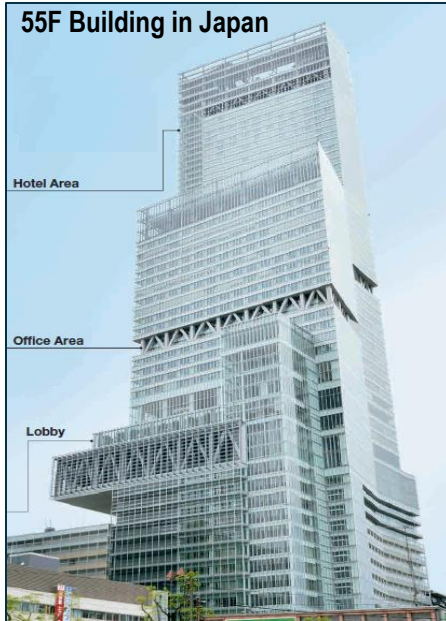


Chiller
12°C → 7°C

12°C water return to chiller,
and water is **cooled down**
from 12°C to 7°C
by chiller

(*It depends on the condition)

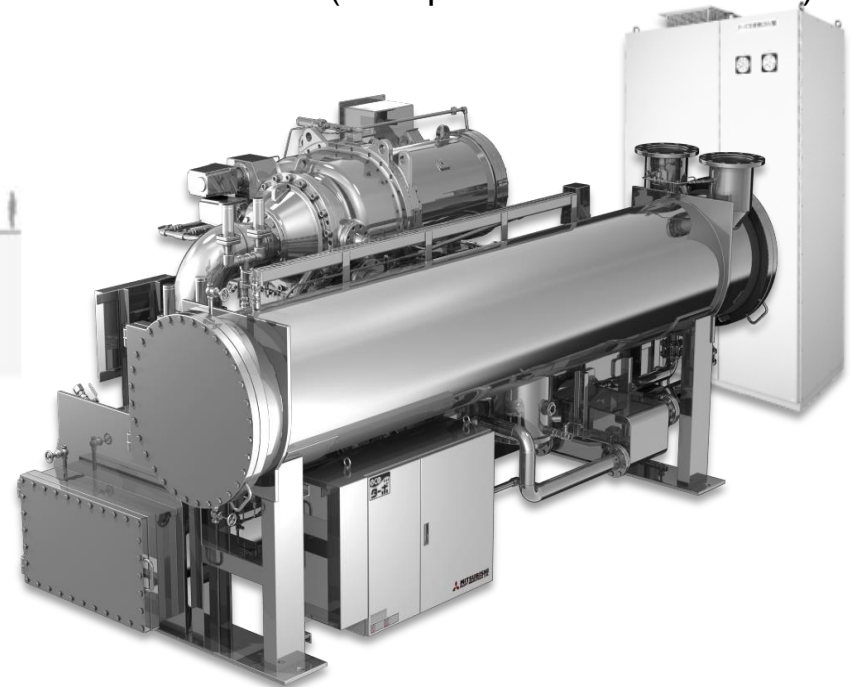



Chiller

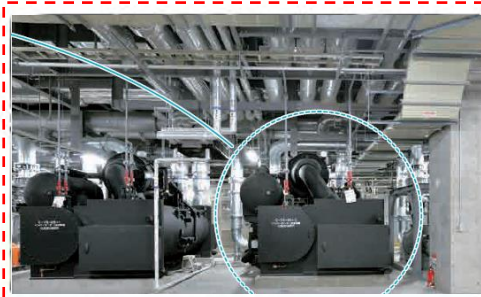

Installed at the underground level

Introduction of Centrifugal Chiller : How it works

(Copyright © PIXTA)

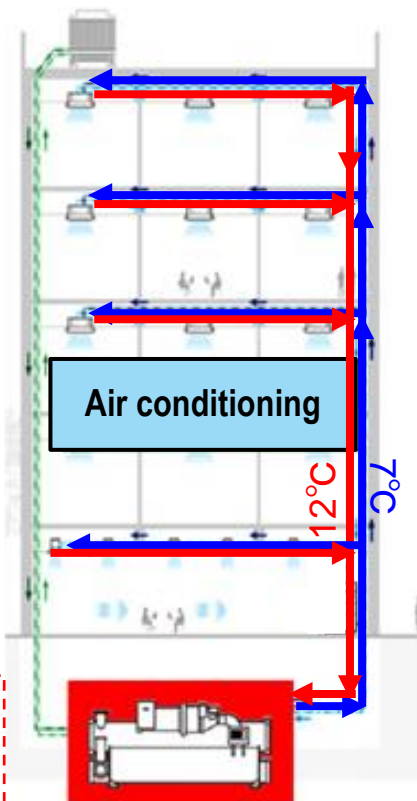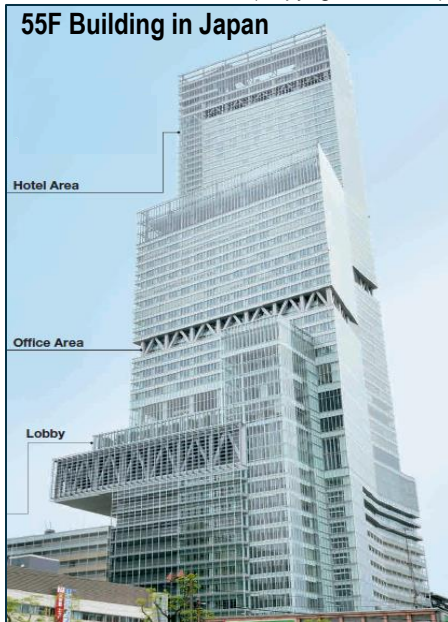

Chiller
12°C → 7°C


For Air conditioning
7°C* Chilled water
is provided by chiller
continuously

(*Normally 5 ~ 7°C)

7°C

Cooling water inlet

Cooling water outlet

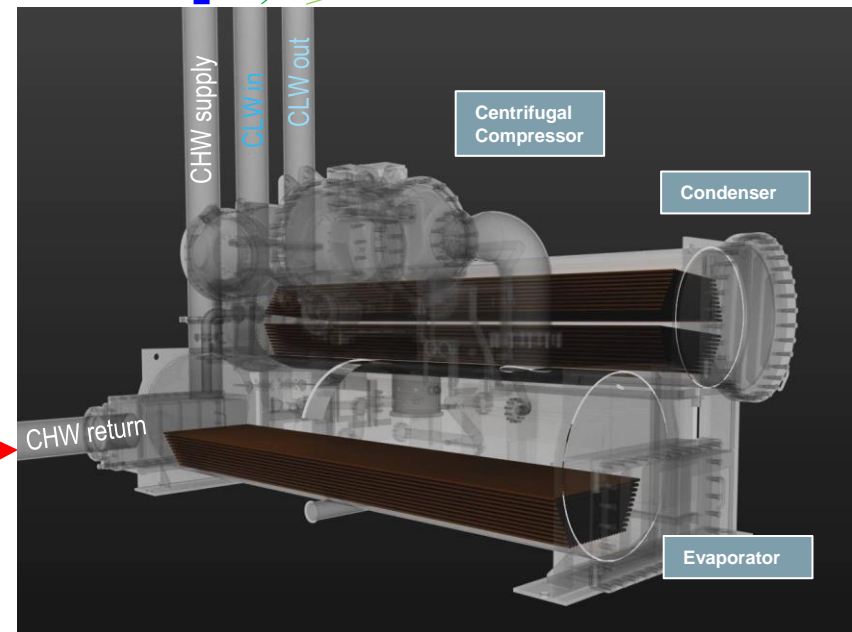




12°C



Installed at the underground level


Introduction of Centrifugal Chiller : How it works

(Copyright © PIXTA)

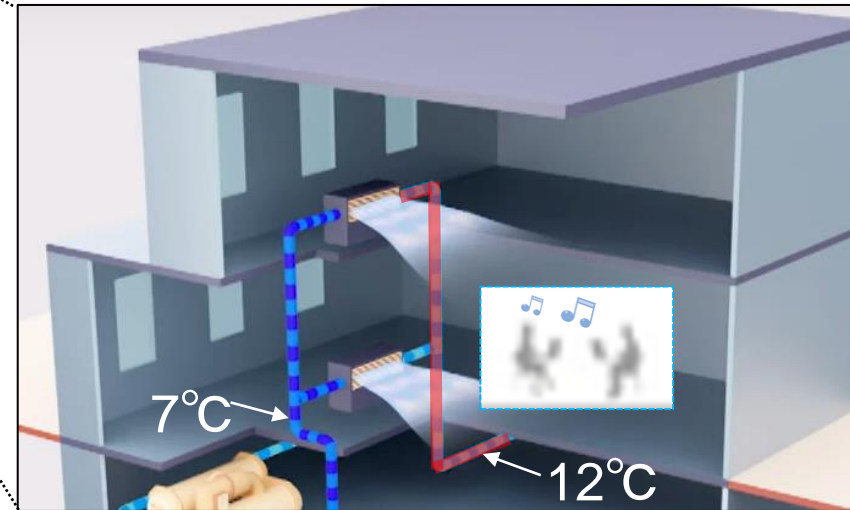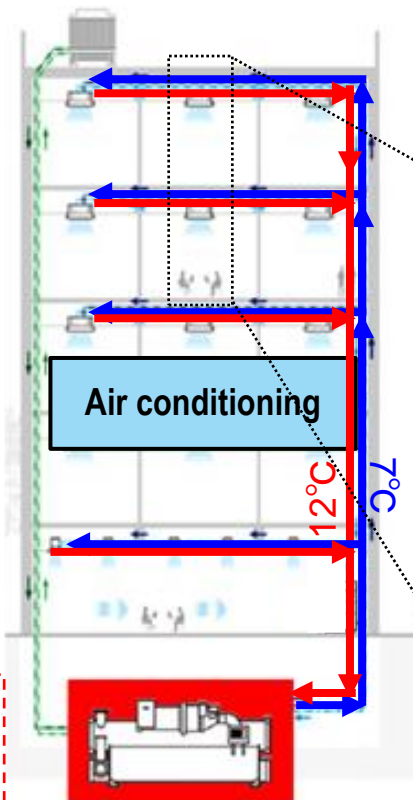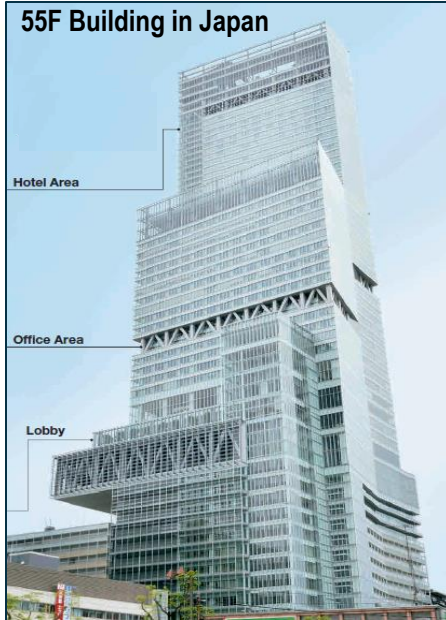

(Source of picture: agency for natural resources and energy)

Chiller

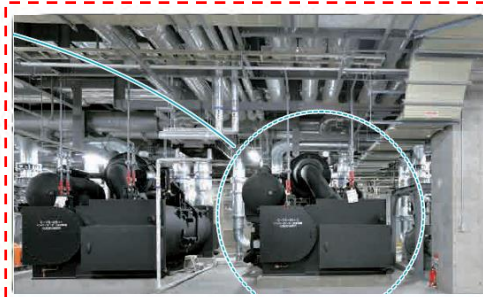

Installed at the underground level

Chiller
12°C → 7°C

Comfortable Space !

Marina Bay New Downtown Singapore

D.H.C.*




853 RT x 1 unit
2000 RT x 2 units
2844 RT x 11 units
3697 RT x 2 units (Total 15 units)

Total 43,531 RT

* D.H.C.: District heating and cooling


Madinah Urban Development Project Saudi Arabia

D.H.C.*

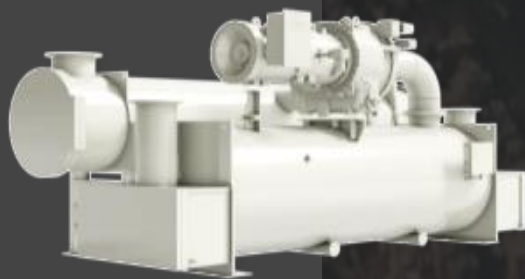

Variable speed
2500 RT x 80 units

Total 200,000 RT



Kansai International Airport Japan

D.H.C.*



1100 RT x 1 unit
1200 RT x 1 unit
2000 RT x 2 units (Total 4 units)

Total 6,300 RT



Chilled water/steam

* D.H.C. : District heating and cooling

Shirakawa Data Center

Japan



400 RT x 2 units




450 RT x 9 units

Amari Hotel Bangkok

Thailand



Introduction of Centrifugal Chiller : Application

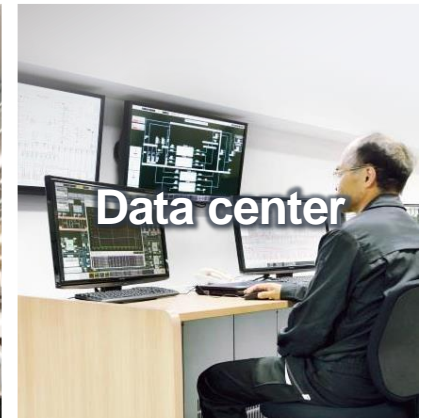


MHI Centrifugal chiller is,

1) High efficiency cooling system

2) Low GWP* refrigerant centrifugal chiller

(*GWP: Global Warming Potential)

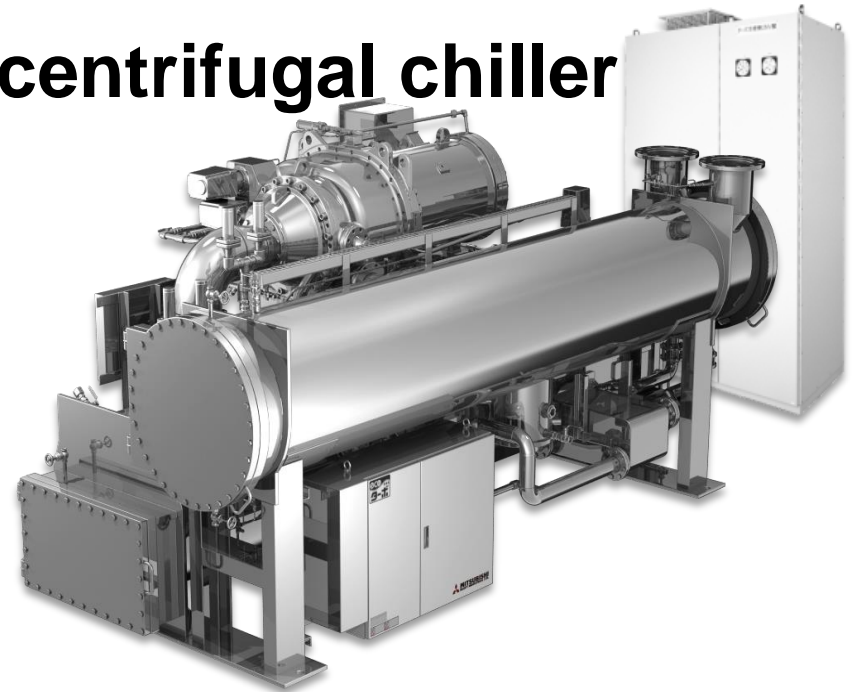

MHI Centrifugal chiller is,


1) **High efficiency** cooling system

➡ Less energy, Reduction of CO2 emission


2) **Low GWP*** refrigerant centrifugal chiller

➡ Reduction of Greenhouse gases emission

(*GWP: Global Warming Potential)

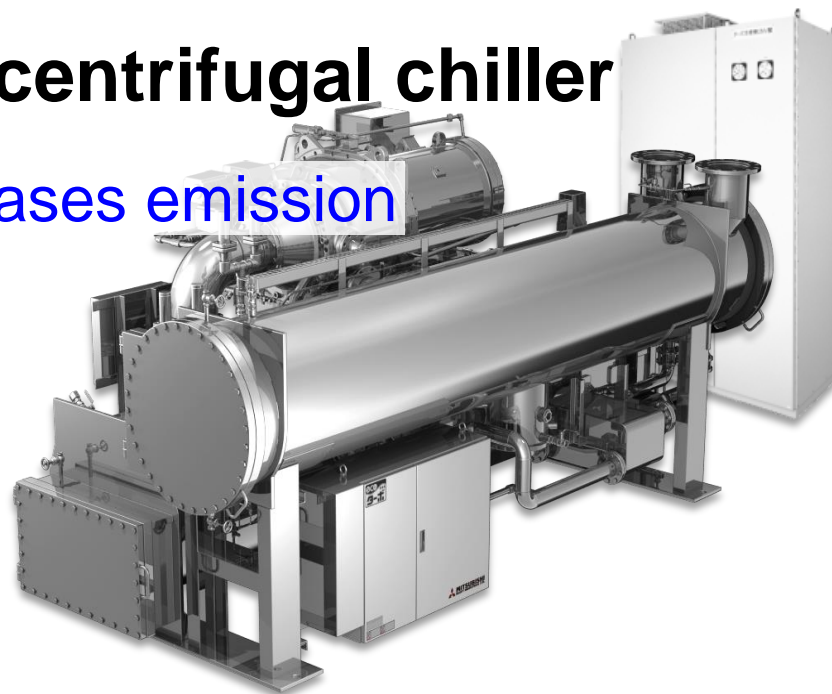


Introduction of GART Series model

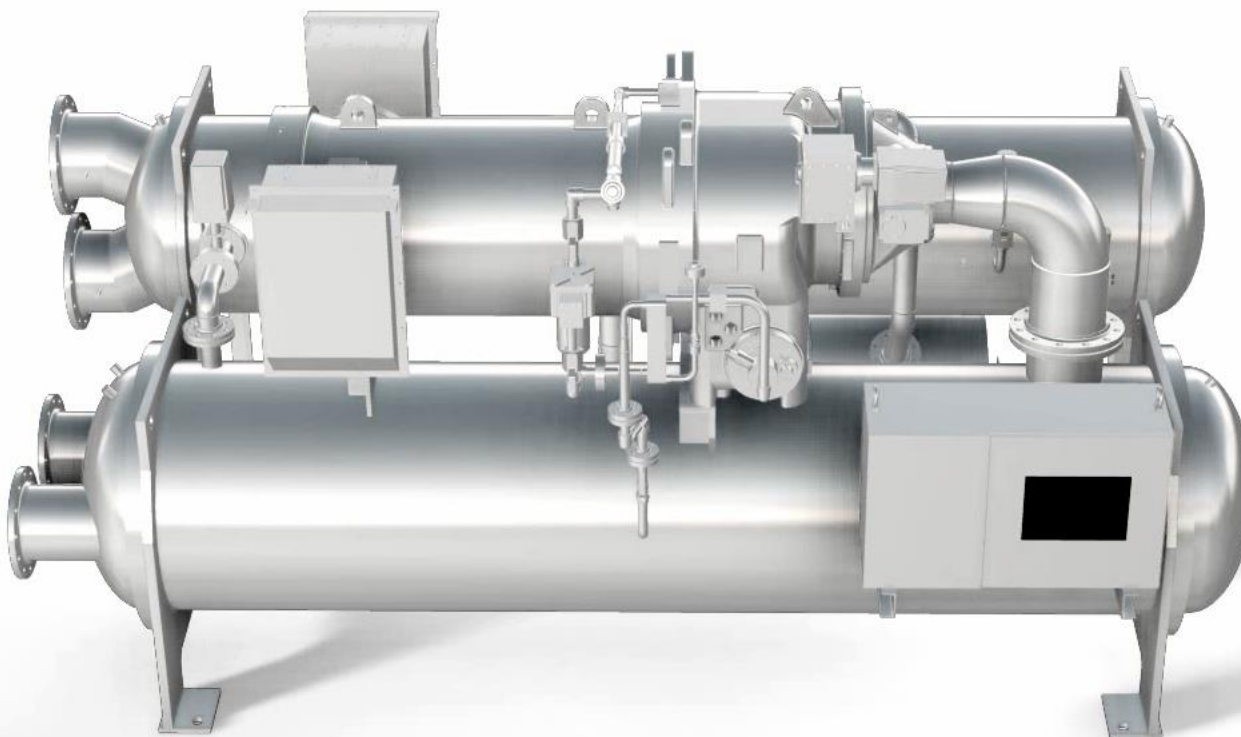

GART-R/P

Introduction of GART Series model

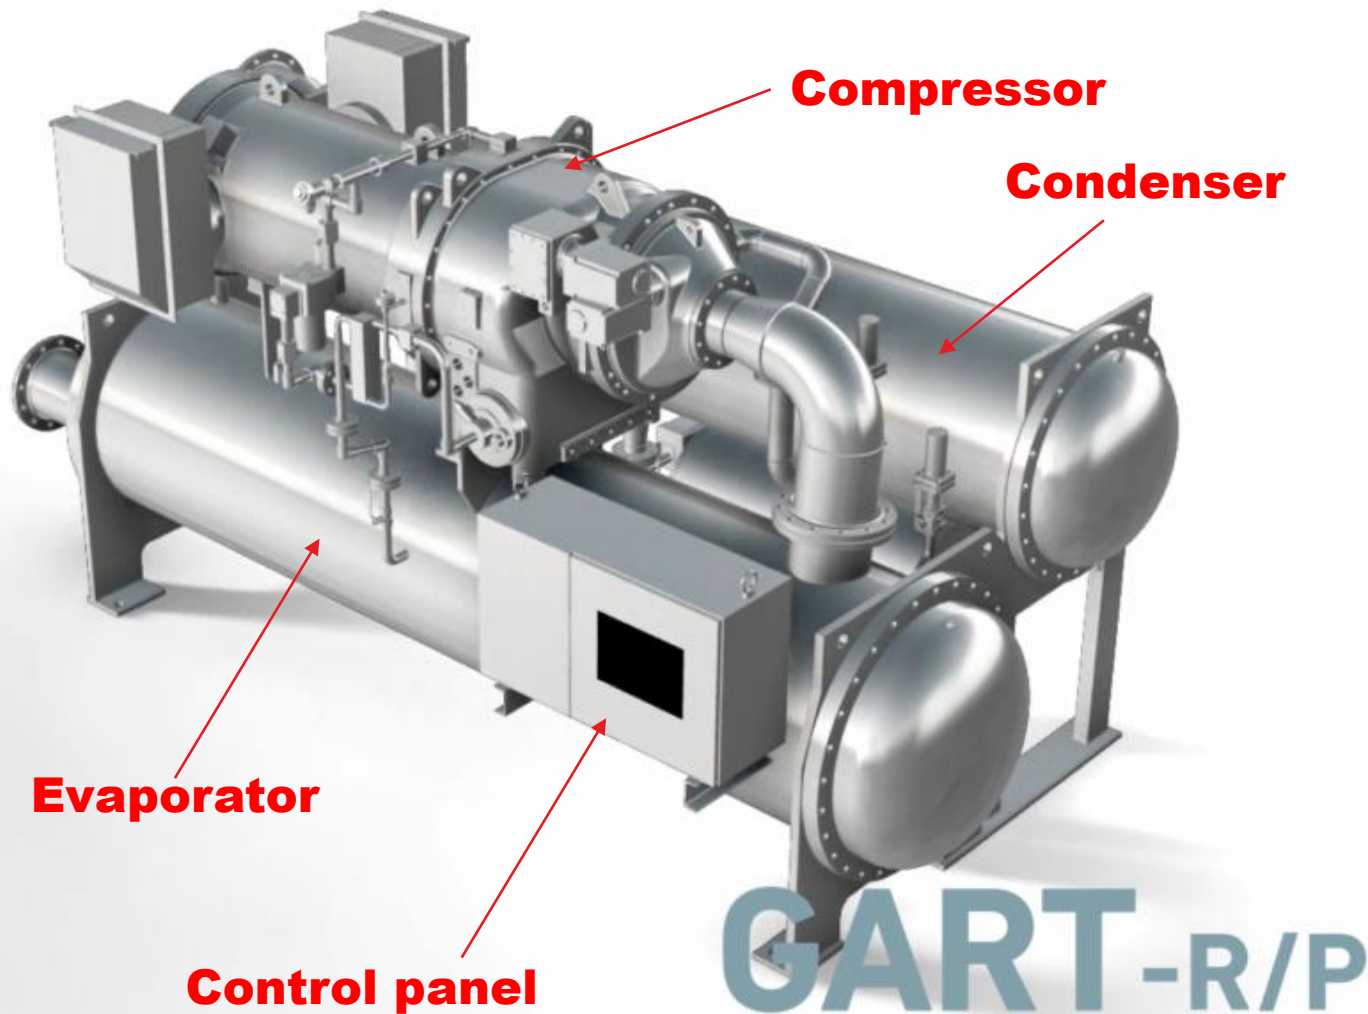

MHI Centrifugal Chiller: GART Series

STANDARD MODEL

FOCUS
POINT

**High
Performance**
(Less energy)

GART **P** Model

Regular

GART **R** Model

CUSTOMIZABLE MODEL

GART

DESIGNED **IN** JAPAN


BASIC TECHNOLOGIES



MHI Centrifugal chiller is,

1) **High efficiency** cooling system




- High performance heat exchangers, optimized cycle
- Centrifugal compressor by MHI technology
- Variable speed control for part load operation
- Ene-Conductor for the total heat source system

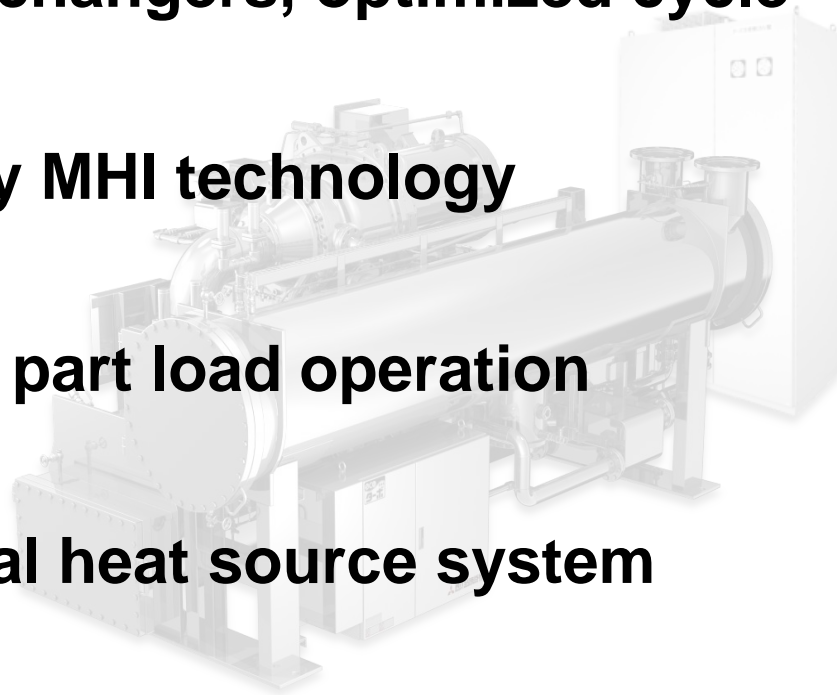

MHI Centrifugal chiller is,

1) **High efficiency** cooling system


- High performance heat exchangers, optimized cycle

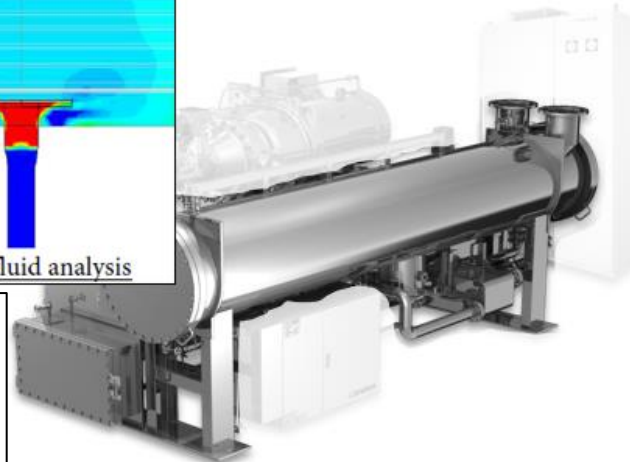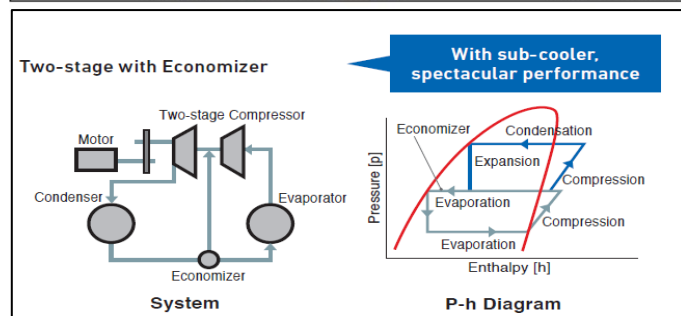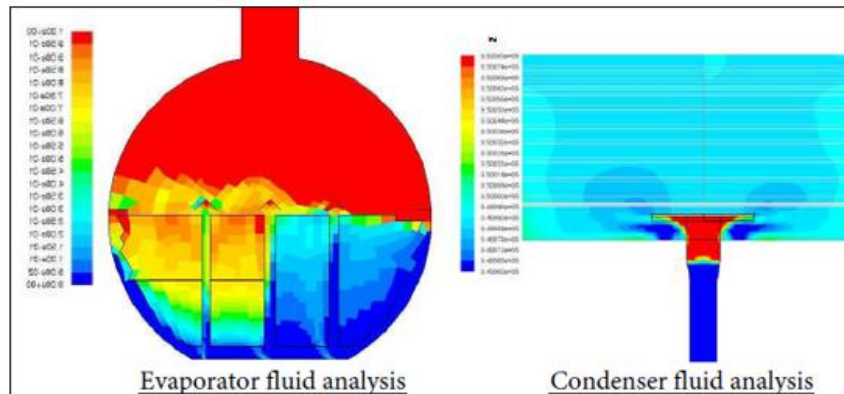

MHI Centrifugal chiller is,

1) **High efficiency** cooling system



- High performance heat exchangers, optimized cycle
- Centrifugal compressor by MHI technology

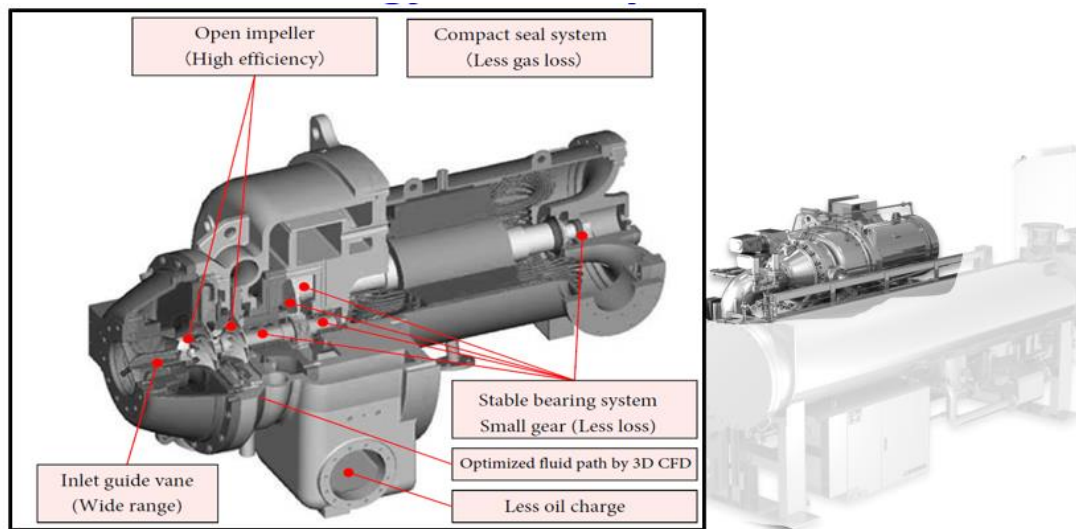

Technology of MHI Centrifugal Chiller: Details

MHI Centrifugal chiller is,

1) **High efficiency** cooling system

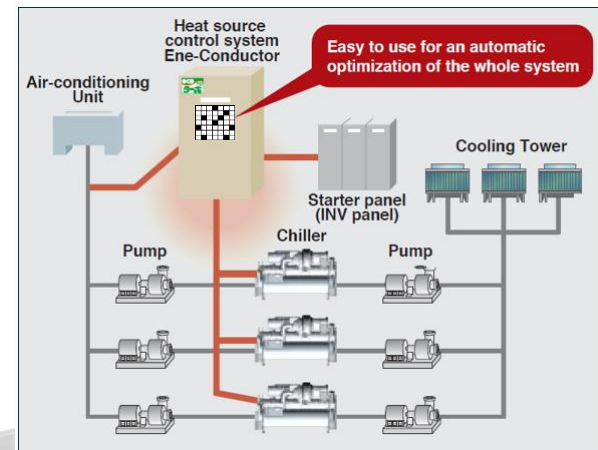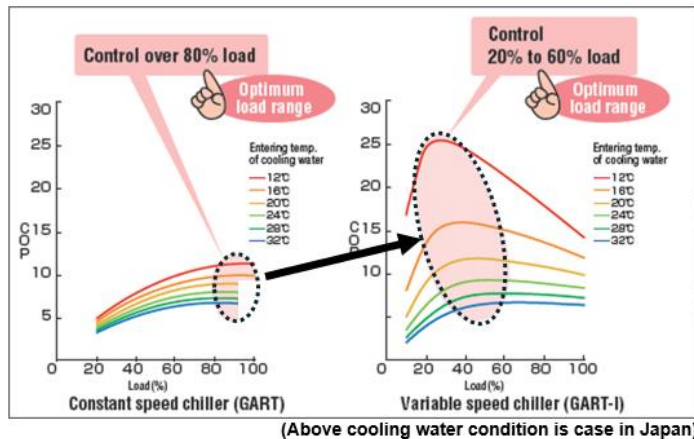


- **Variable speed control for part load operation**
- **Ene-Conductor for the total heat source system**

MHI Centrifugal chiller is,

1) **High efficiency** cooling system technology

- High performance heat exchangers, optimized cycle
- Centrifugal compressor by MHI technology
- Variable speed control for part load operation
- Ene-Conductor for the total heat source system

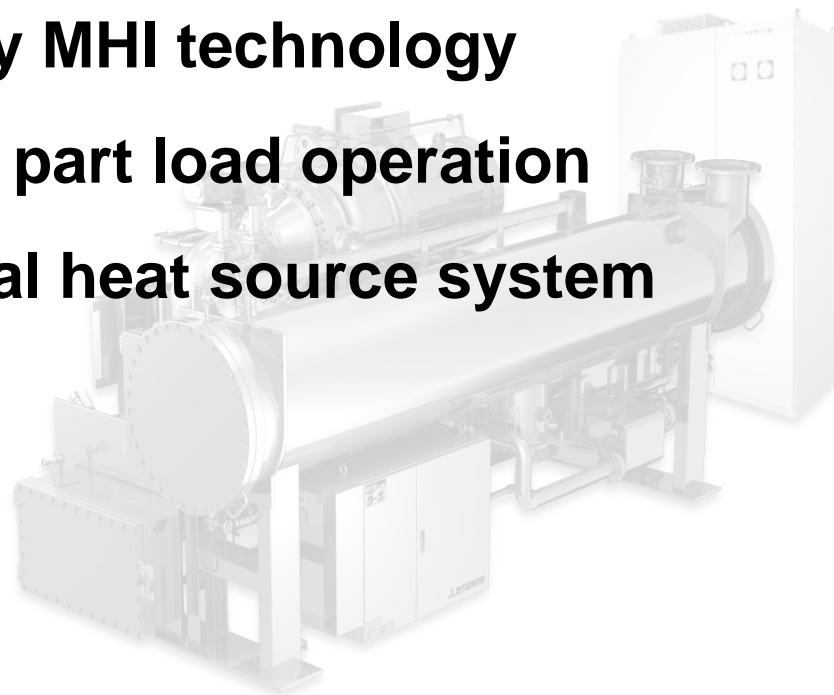

MHI Centrifugal chiller is,

1) **High efficiency** cooling system


- High performance heat exchangers, optimized cycle
- Centrifugal compressor by MHI technology
- Variable speed control for part load operation
- Ene-Conductor for the total heat source system

ENERGY SAVING IS ACHIEVED !

➡ REDUCTION OF CO2 EMISSION



Case introduction : CO2 emission reduced case study

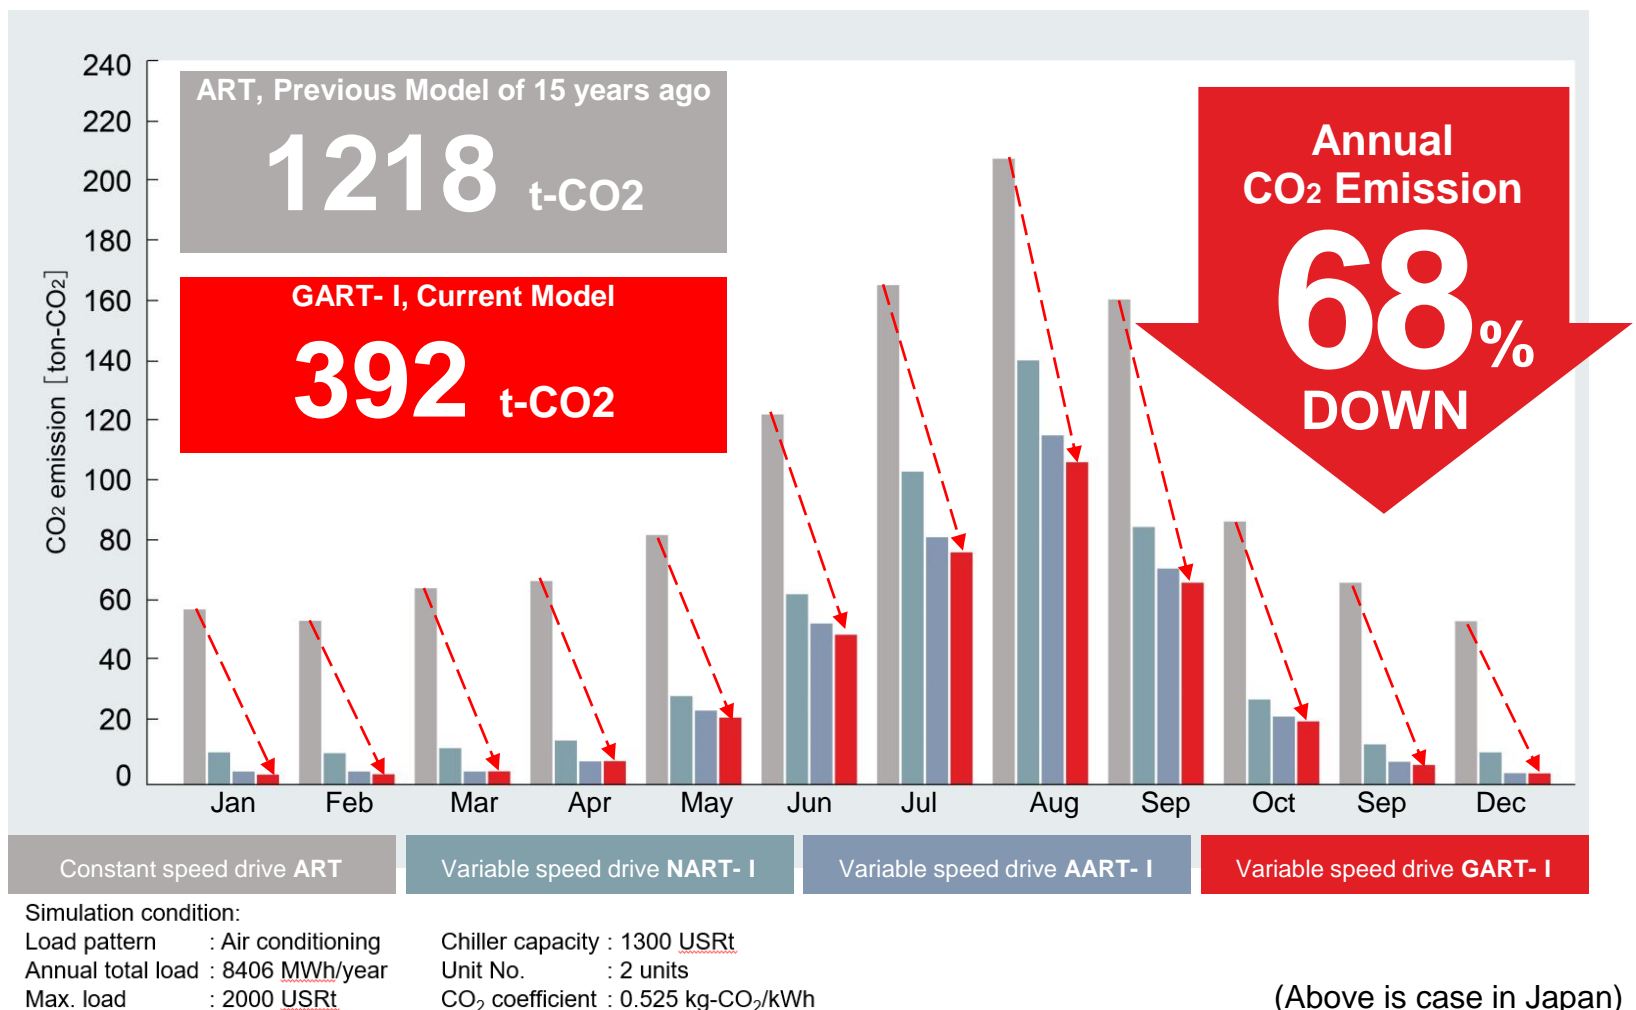

Case introduction : CO2 emission reduced

Before

Variable Speed Drive
MHI Centrifugal Chiller
(Previous Model NART-I Series)




After


Variable Speed Drive
MHI Centrifugal Chiller
(Existing Model ETI Series)




Ene-Conductor

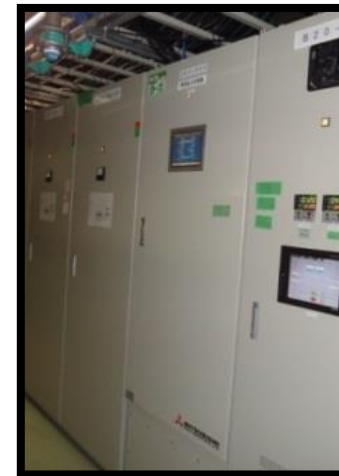

Case introduction : CO2 emission reduced

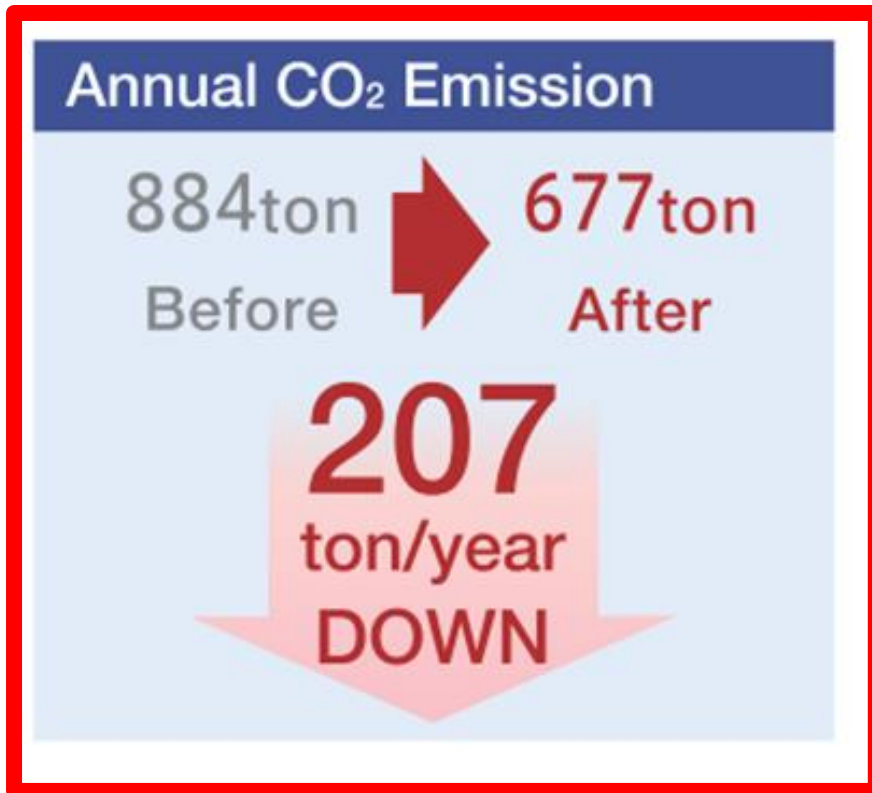

*CO₂ emission was calculated using CO₂ emission factor 0.546kg-CO₂/kWh (FY2011 actual record by Tohoku Electric Power Co., Inc.)

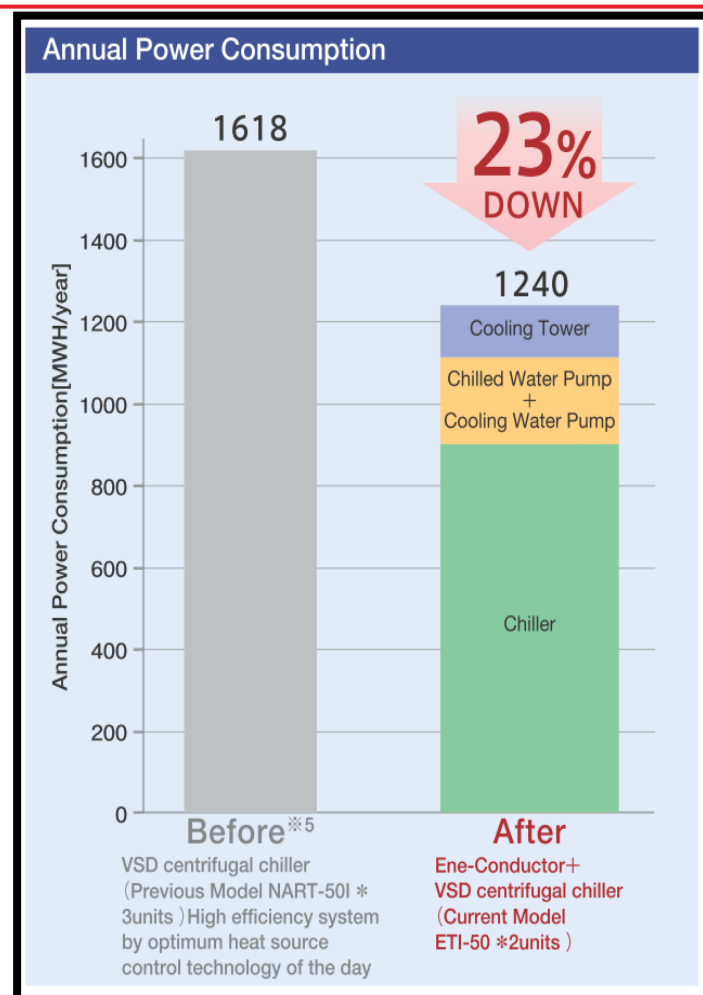


*Power consumption (Before) is calculated based on 2012 data divided by 2004 System COP 5.9 (Above is case in Japan)

Case introduction : CO2 emission reduced



Energy Saving & Cost Reduction Effect
(comparison with the other brand's existing chiller)

■ Annual Electric Power Consumption (Result)

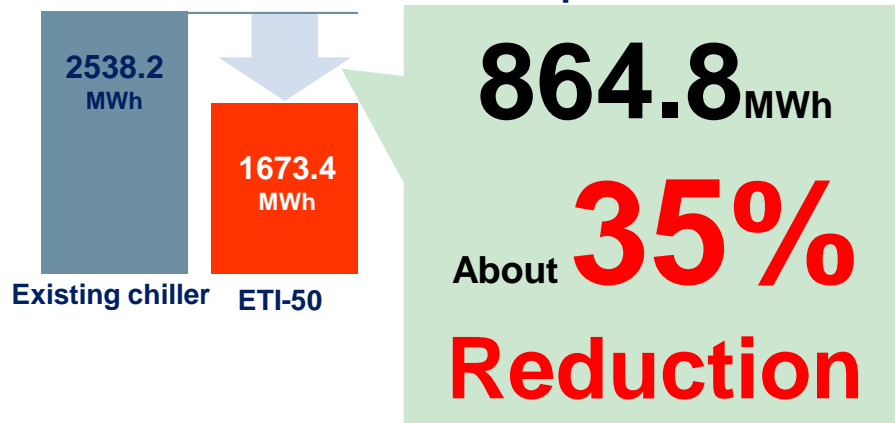


Variable speed drive centrifugal chiller
500 RT x 1 unit (ETI-50)

MHI Centrifugal chiller is,

2) **Low GWP*** refrigerant centrifugal chiller

➔ Reduction of **Greenhouse gases** emission

(*GWP: Global Warming Potential)

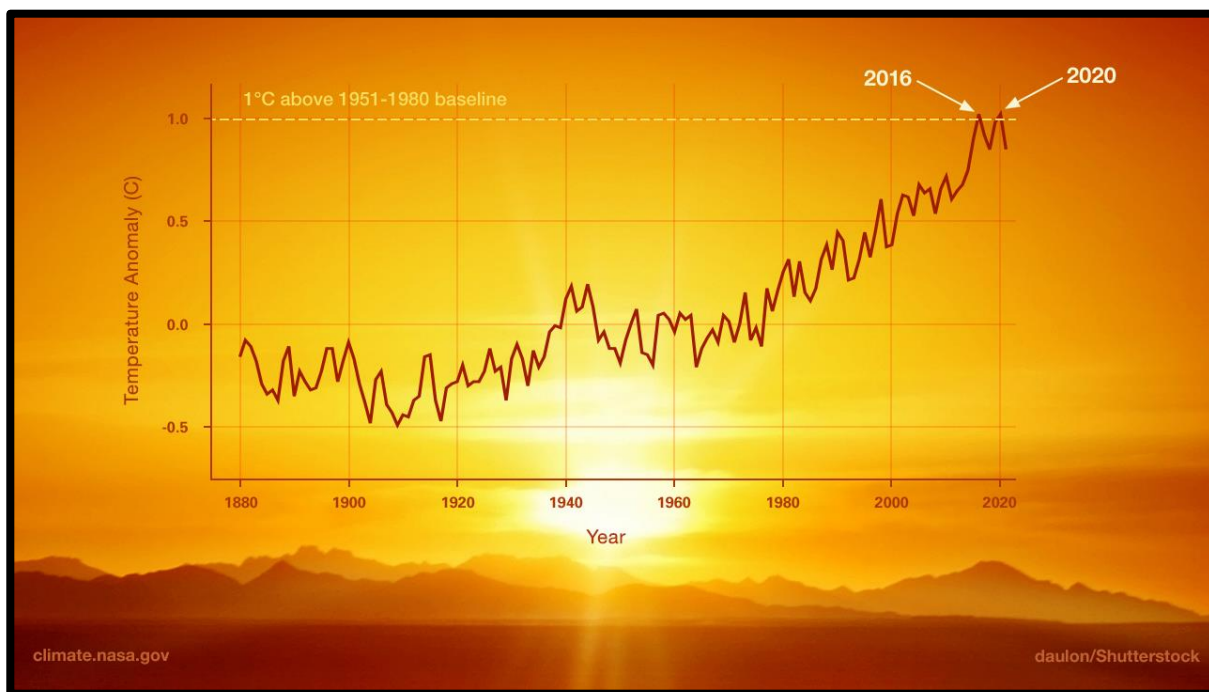


MHI Centrifugal chiller is,

2) **Low GWP*** refrigerant centrifugal chiller

➔ Reduction of **Greenhouse gases** emission

(*GWP: Global Warming Potential)

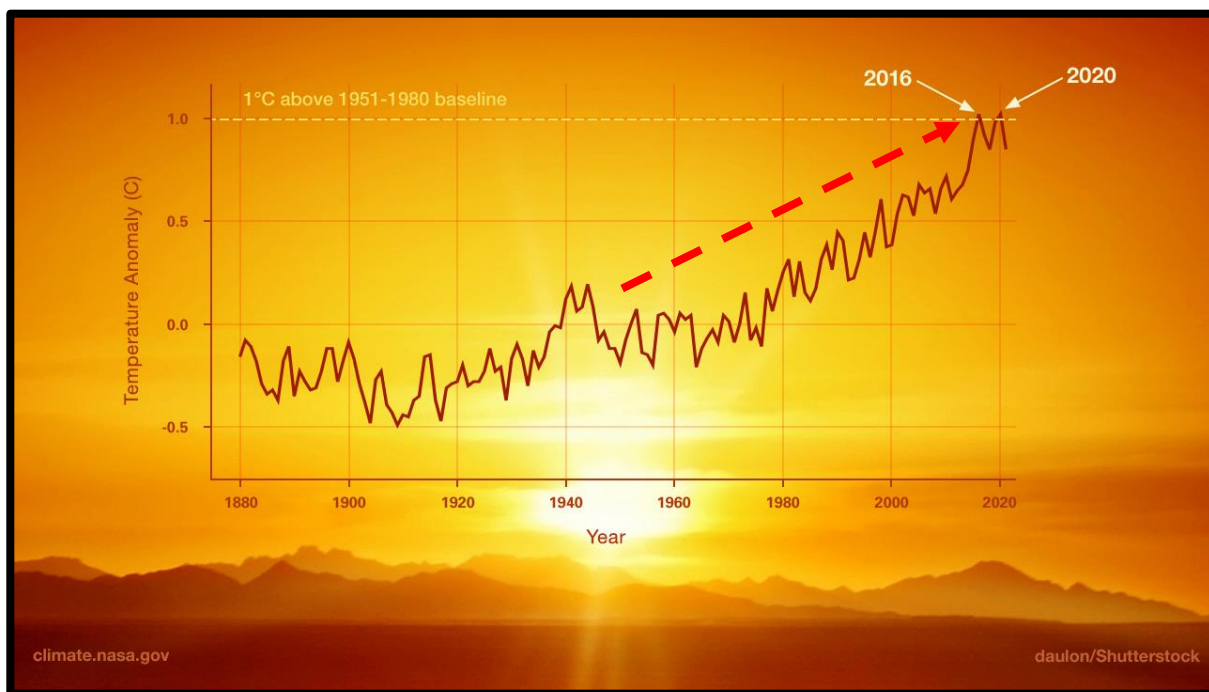

MHI Centrifugal chiller is,

2) **Low GWP*** refrigerant centrifugal chiller

→ Reduction of **Greenhouse gases** emission

(*GWP: Global Warming Potential)




(Source of picture: <https://www.pref.toyama.jp/1705/kurashi/kankyoushizen/kankyou>)

2) Low GWP refrigerant centrifugal chiller


Montreal Protocol "Kigali Amendment" (2016)

HFCs (Hydrofluorocarbons) are added as substances requires gradual phasedown, because **HFCs** are **Greenhouse Gases** many times more potent than CO₂.

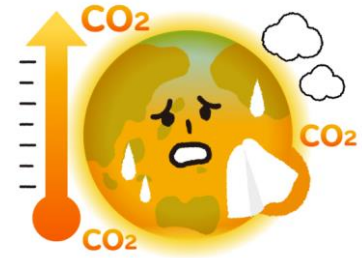

2) Low GWP refrigerant centrifugal chiller

Montreal Protocol "Kigali Amendment" (2016)

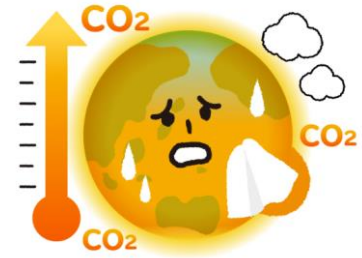

HFCs (Hydrofluorocarbons) are added as substances requires gradual phasedown, because **HFCs** are **Greenhouse Gases** many times more potent than CO₂.


Refrigerant	CFC (Chlorofluorocarbons)		HCFC (Hydrochlorofluorocarbon)		HFC (Hydrofluorocarbons)		HFO (Hydrofluoroolefin)		
	R11	R12	R22	R123	R245fa	R134a	R1234yf	R1234ze(E)	R1233zd(E)
GWP *2 (Global Warming Potential)	4660	10200	1760	79	858	1300	< 1	< 1	1
ODP *3 (Ozone Depletion Potential)	1	1	0.055	0.02	0	0	0	0	≐ 0

*1. Greenhouse gases warm the Earth by absorbing energy and slowing the rate at which the energy escapes to space.

*2. GWP is the heat absorbed by any greenhouse gas in the atmosphere, as a multiple of the heat that would be absorbed by the same mass of carbon dioxide (CO₂). GWP is 1 for CO₂. GWPs listed are IPCC 5th report (2013), 100-year GWPs.

*3. ODPs is the relative amount of degradation to the ozone layer it can cause.

2) Low GWP refrigerant centrifugal chiller

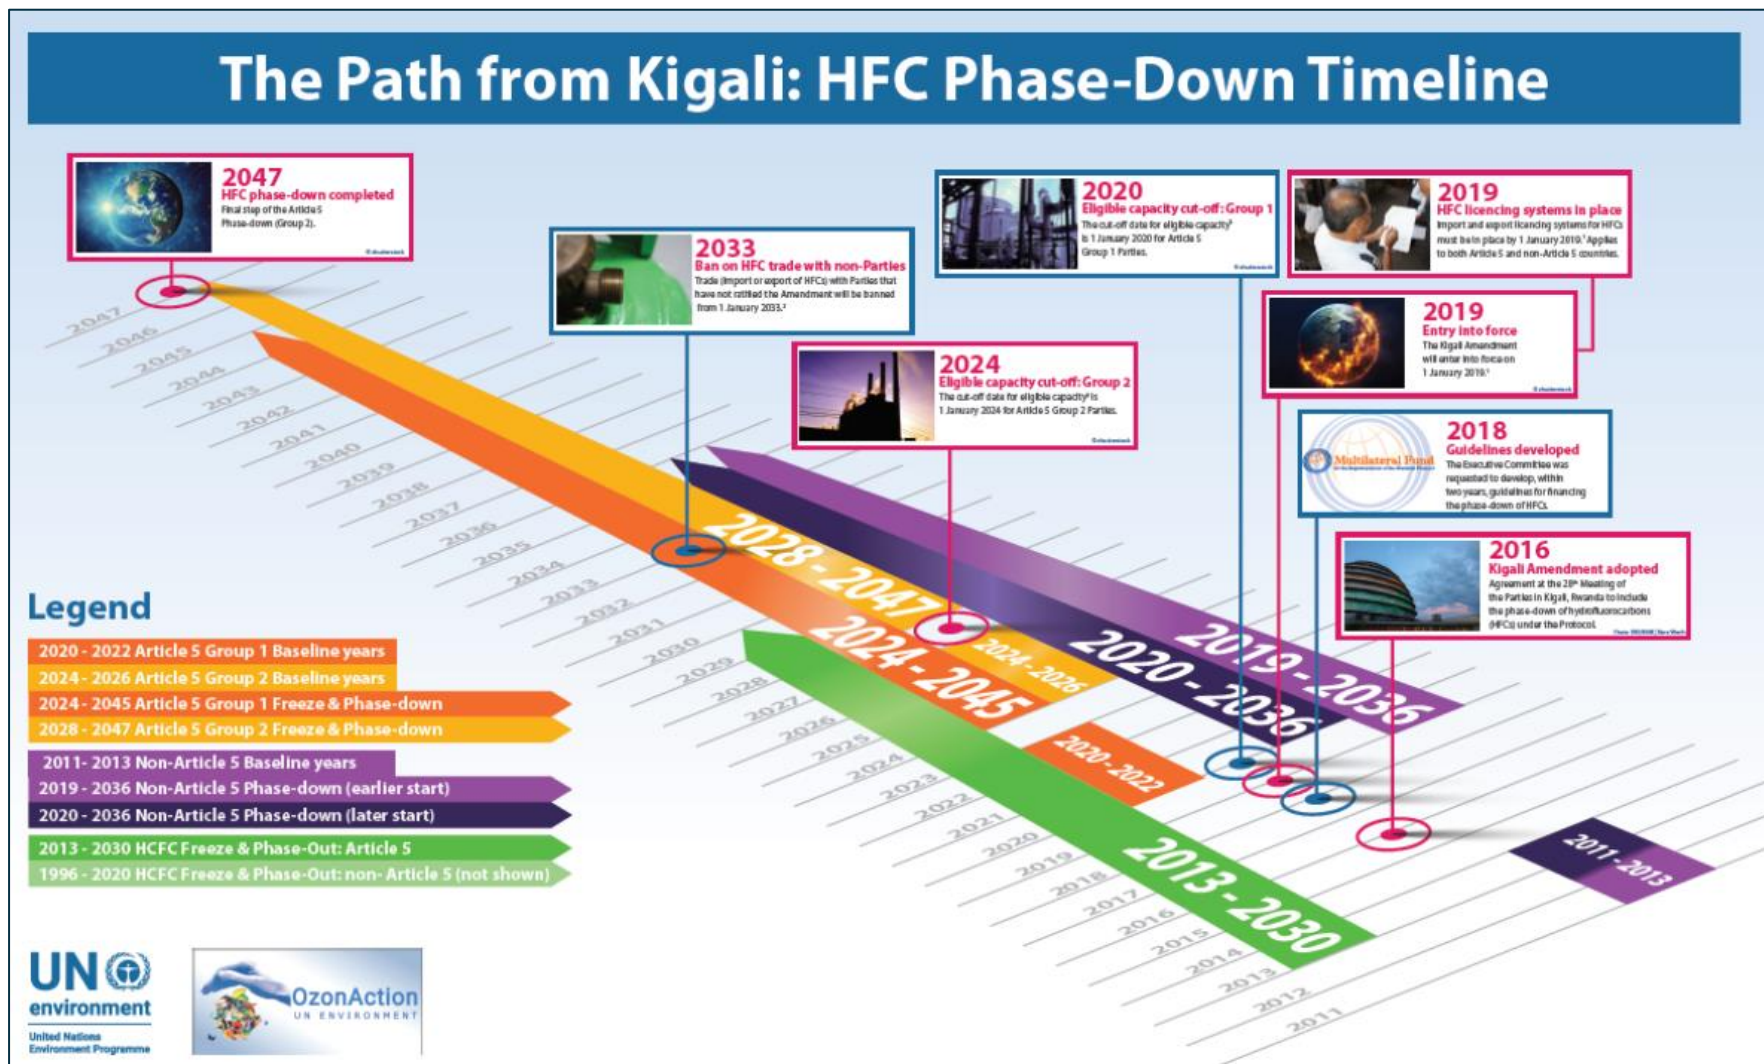

From website 「<https://www.unep.org/ozonaction/who-we-are/about-montreal-protocol/>」

2) Low GWP refrigerant centrifugal chiller

MISSION NET ZERO

Through our group products, technologies, and services that help reduce CO₂ emissions, as well as new solutions and innovations to be developed with partners around the world, Mitsubishi Heavy Industries Group will contribute to realizing net zero emissions for the world as a whole.

To this end, each and every one of our employees is embracing and internalizing "MISSION NET ZERO" and will act to implement a net zero future.



MHI provide

Low GWP HFO refrigerant Centrifugal chiller

Refrigerant	CFC (Chlorofluorocarbons)		HCFC (Hydrochlorofluorocarbon)		HFC (Hydrofluorocarbons)		HFO (Hydrofluoroolefin)		
	R11	R12	R22	R123	R245fa	R134a	R1234yf	R1234ze(E)	R1233zd(E)
GWP *2 (Global Warming Potential)	4660	10200	1760	79	858	1300	< 1	< 1	1
ODP *3 (Ozone Depletion Potential)	1	1	0.055	0.02	0	0	0	0	≐ 0

*1. Greenhouse gases warm the Earth by absorbing energy and slowing the rate at which the energy escapes to space.

*2. GWP is the heat absorbed by any greenhouse gas in the atmosphere, as a multiple of the heat that would be absorbed by the same mass of carbon dioxide (CO₂). GWP is 1 for CO₂. GWPs listed are IPCC 5th report (2013), 100-year GWPs.

*3. ODPs is the relative amount of degradation to the ozone layer it can cause.

2) Low GWP refrigerant centrifugal chiller



Low GWP Refrigerant
 HFO-1234ze(E)
 Next generation centrifugal chiller

GART-
 Constant speed Variable speed
ZE & ZE I series

GART-ZE, ZE I series

HFO-1234ze(E) is applied.




Low GWP Refrigerant
 HFO-1233zd(E)
 Next generation centrifugal chiller

ETI-Z Variable speed series

ETI-Z series


HFO-1233zd(E) is applied.



2) Low GWP refrigerant centrifugal chiller

GART-ZE, ZEI series


Up to 5000USRt can be applied by GART-ZE.PL (Dual compressor)

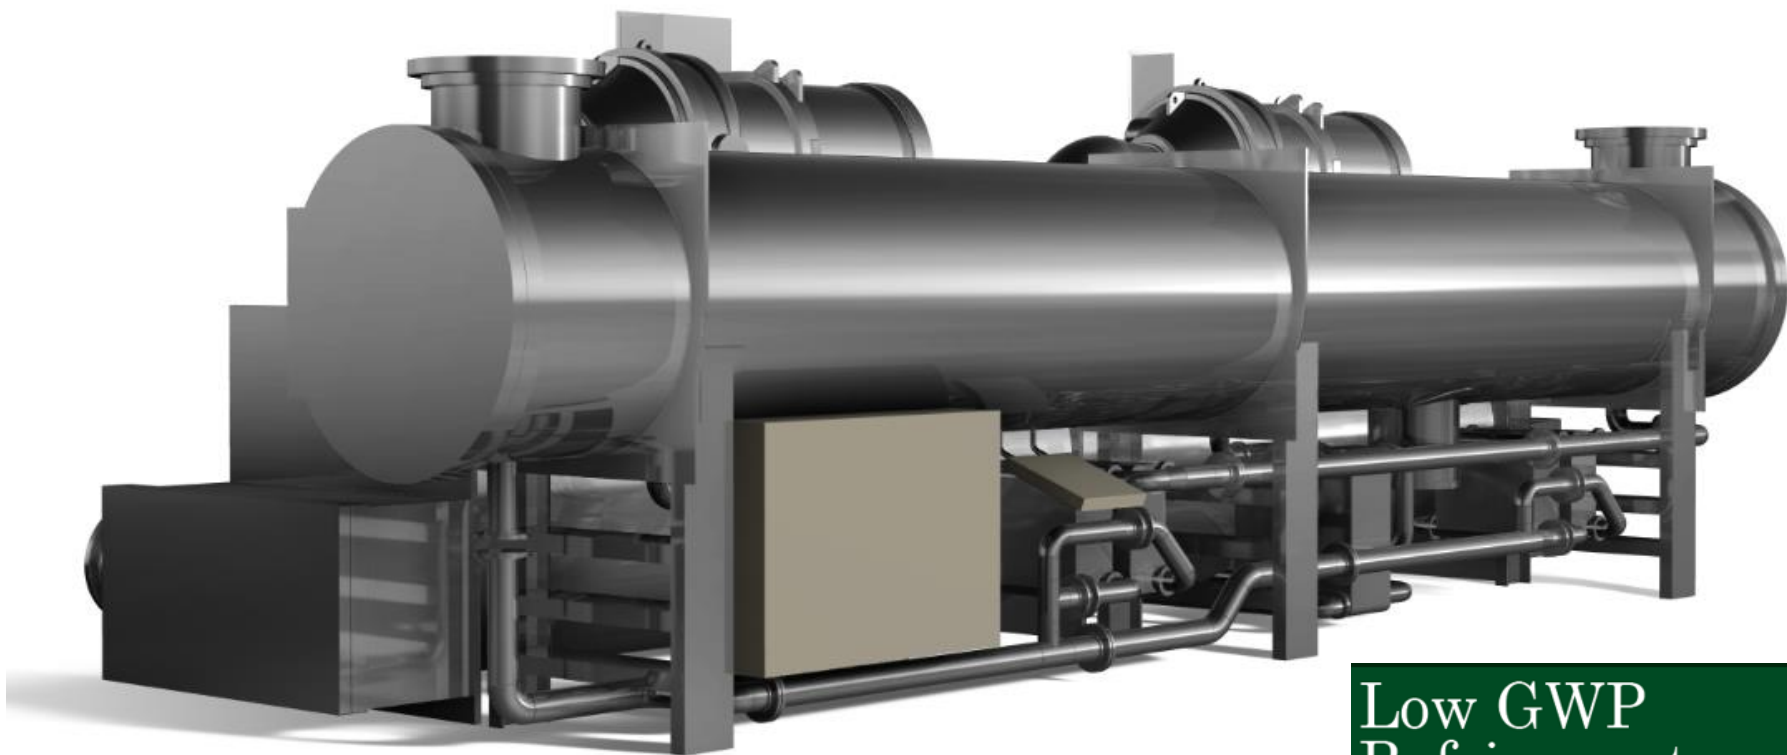

**Low GWP
Refrigerant**
HFO-1234ze(E)
Next generation centrifugal chiller

2) Low GWP refrigerant centrifugal chiller

ENERGY CONSERVATION GRAND PRIZE is awarded
in 2018, Japan.

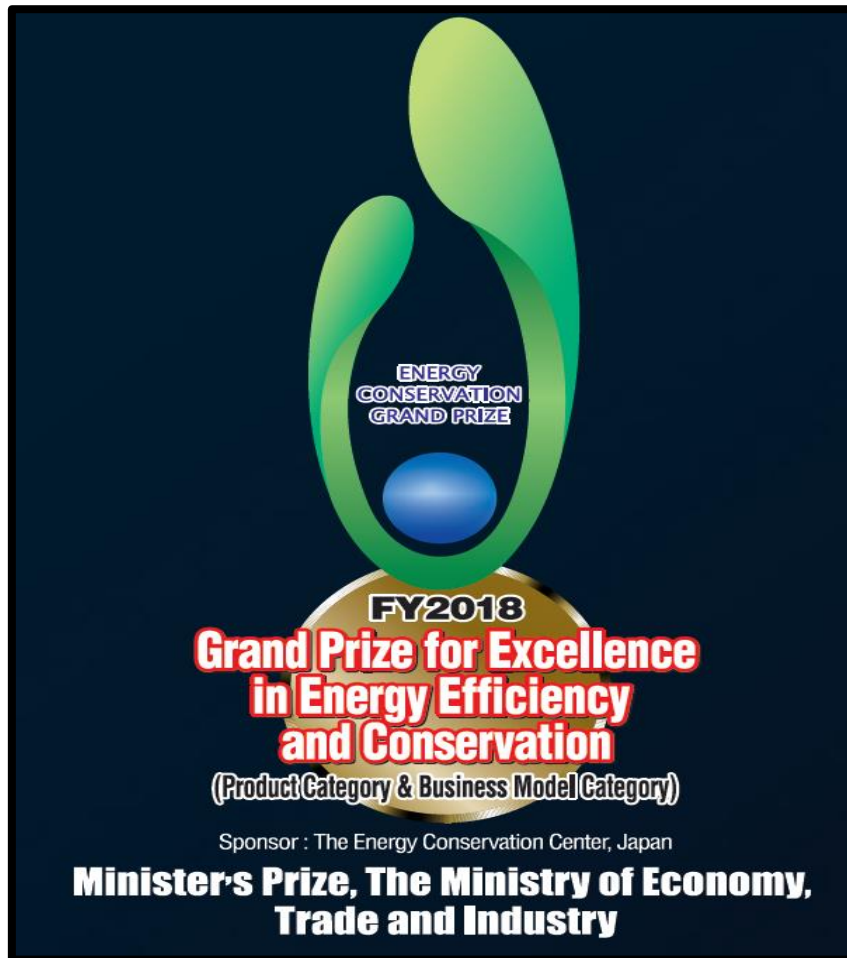

ETI-Z series





**Low GWP
Refrigerant**
HFO-1233zd(E)
Next generation centrifugal chiller

2) Low GWP refrigerant centrifugal chiller

MHI Centrifugal chiller

for **HFC-134a** and **HFO-1234ze(E), 1233zd(E)**

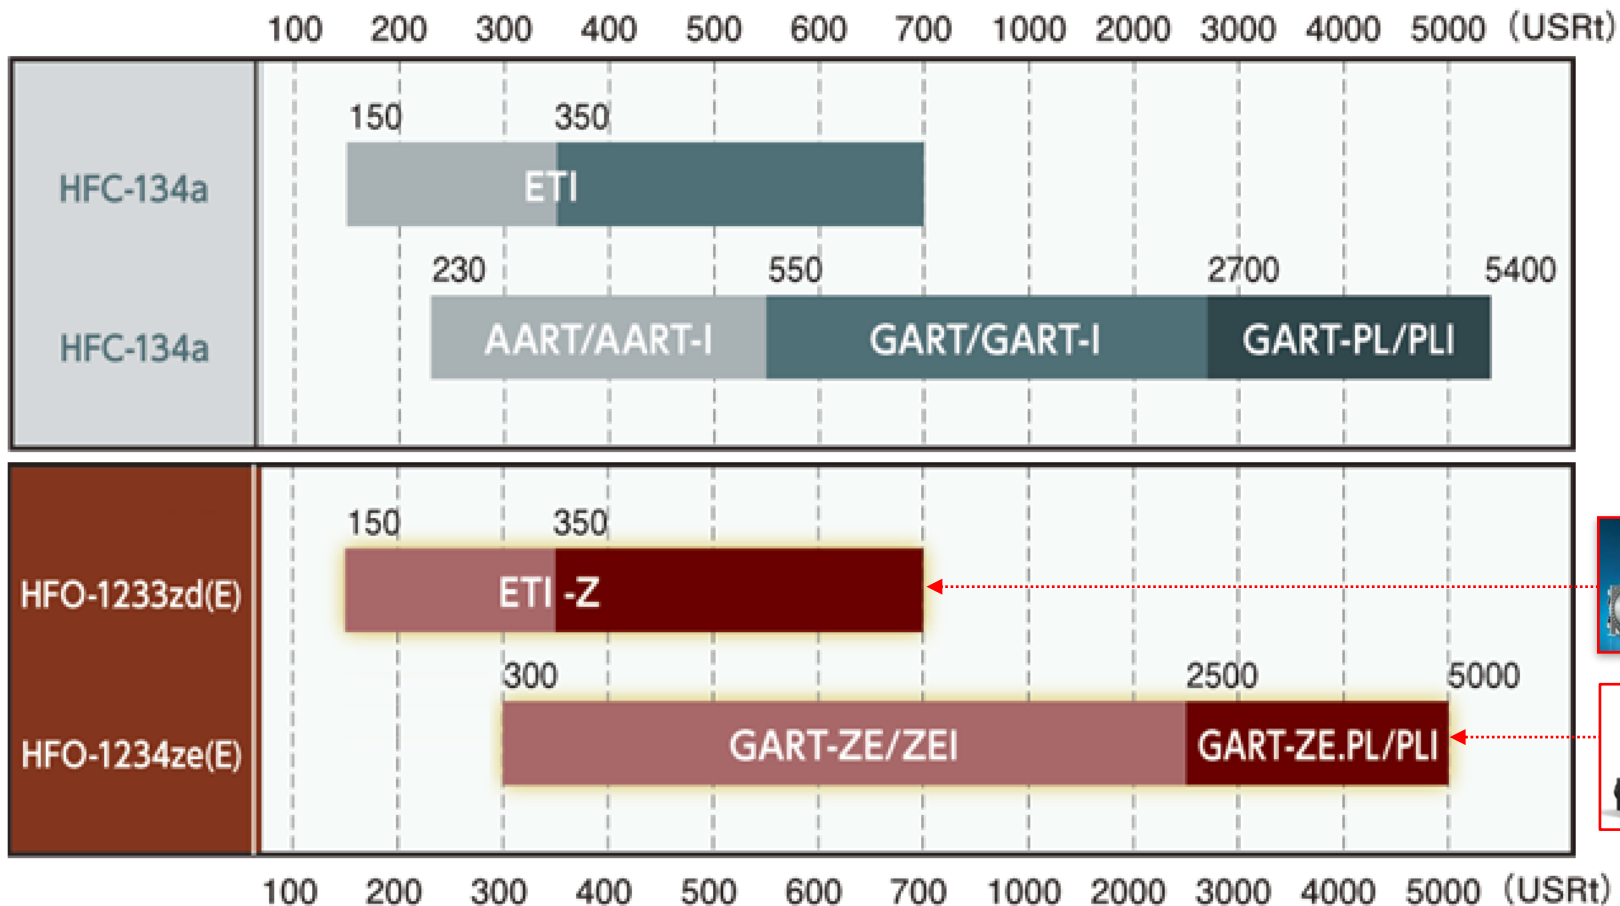


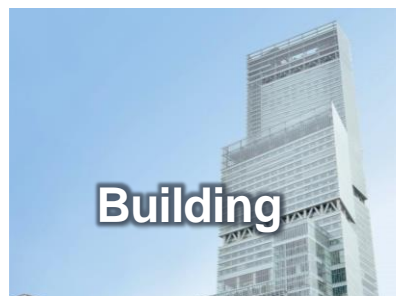

Building



**Office · Hotel ·
Hospital**

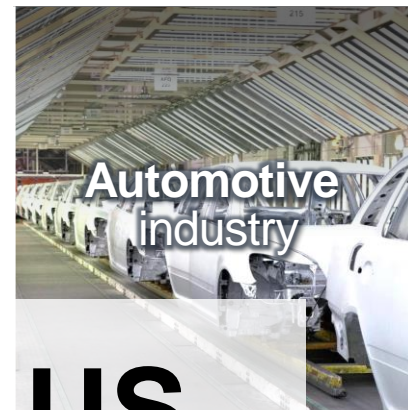

**Automotive
industry**

PLEASE CONTACT US



District cooling



Clean room



Shopping mall



Data center



**Semiconductor
industry**



Sports facility



**Chemical · Food
industry**

CARBON NEUTRALIZATION **WITH MHI CENTRIFUGAL CHILLER**

Less energy, Reduction of CO2 emission

Reduction of Greenhouse gases emission



CARBON NEUTRALIZATION **WITH MHI CENTRIFUGAL CHILLER**

THANK YOU

Prehantono Eko Setiabudi

Sales
PT. Mitsubishi Heavy Industries Indonesia
Tel: +62-811-895908
Email: eko.prehantono.n2@mhi.com

Kenichi Omura

Global Sales (located in Japan)
Mitsubishi Heavy Industries Thermal Systems, Ltd.
Tel: +81-90-3041-9411
Email: kenichi.omura.yu@mhi.com

Jinwoong Lee

Engineering (located in Japan)
Chiller & Heat Pump Engineering Department
Mitsubishi Heavy Industries Thermal Systems, Ltd.
Tel: +81-80-8903-6390
Email: Jinwoong.lee.tw@mhi.com



MOVE THE WORLD FORWARD

**MITSUBISHI
HEAVY
INDUSTRIES
GROUP**